

2016 Wastewater Collection and Treatment Report



Salmon River

TABLE OF CONTENTS

| | Page # |
|---|--------|
| 1.0 Community General | 2 |
| 1.1 Staffing | 3 |
| 2.0 Wastewater Collection System | 4 |
| 2.1 Wastewater Collection System History | 4 |
| 2.2 Wastewater Treatment Plant History | 5 |
| 3.0 Wastewater Treatment and Collection System | 7 |
| 3.1 Overview of Collection System | 7 |
| 3.2 Collection System | 7 |
| 3.3 Lift Stations | 7 |
| 3.4 Wharf Street Pump Station | 8 |
| 3.5 Lift Station Repairs and Modifications | 8 |
| 3.6 Sanitary Flushing | 8 |
| 3.7 Main and Service Interruptions | 8 |
| 3.8 Inflow and Infiltration Monitoring | 8 |
| 3.9 Wastewater Collection Capital Projects | 9 |
| 4.0 Water Pollution Control Centre (WPCC) | 10 |
| 4.1 Process Overview | 10 |
| 4.2 Flows | 13 |
| 4.3 Nutrient Removal | 14 |
| 4.4 Fecal Coliform | 16 |
| 4.5 Toxicity | 16 |
| 4.6 Biosolids | 16 |
| 4.7 Operating Certificate | 17 |
| 4.8 Liquid Waste Management Plan | 17 |
| 4.9 WPCC Capital Projects | 17 |

APPENDIX A Map 3.2 District of Salmon Arm Wastewater Collection System
Dayton & Knight (figure 4.1)

APPENDIX B Operational Certificate

1.0 Community General

The City of Salmon Arm is located in the southern interior of British Columbia on the southwest shoreline of the extensive Shuswap Lake system. With over 17,000 residents, Salmon Arm is the largest urban centre in the Columbia Shuswap Regional District. It serves as the commercial, cultural and administrative hub for an additional 35,000 residents of the Shuswap Lake region. Located at the junction of the Trans Canada Highway (TCH) and Highway 97B, Salmon Arm is a one-half day drive to Vancouver or Calgary and a 70 minute drive to Kelowna or Kamloops.

With a land base of 175 km², Salmon Arm is a relatively large municipality by area with most of the population concentrated within a few kilometers of the Trans Canada Highway and the downtown core. The surrounding terrain varies from the low lying marsh flats of Salmon Arm Bay to the extinct volcanic peak of Mt. Ida and the ridge lines of Fly Hills to the west and Larch Hills to the east. These highlands form the Canoe Creek and Salmon River watersheds which empty into Shuswap Lake. Sustainable land use planning over the years has resulted in the formation of an attractive, bustling, compact community surrounded by thousands of hectares of arable farmland, green space and natural shorelines.



Salmon Arm's commercial and industrial base is continuing to diversify. The housing market continues to remain tight. Retail, construction, professional services and healthcare, along with a wide array of entrepreneurial activities, are major sources of employment. Small businesses



flourish in Salmon Arm's business friendly environment. Key economic drivers are value-added wood processing, high tech and traditional manufacturing, tourism and agri-business. The continuing surge in construction activity points to a healthy market demand for new housing and floor space for commercial, industrial and institutional uses. The 2011 Census indicates a percentage growth in population of 9.1% from the previous 2006 Census. This compares to the national average growth of 5.9%.

1.1 Staffing

The City of Salmon Arm Engineering and Public Works Department is responsible for this municipal function. The Utilities Division is responsible for the operation and maintenance of the sanitary collection system and the Water Pollution Control Centre (WPCC) staff is responsible for the operation and maintenance of the Wastewater Treatment facility and the main lift Station located at Wharf Street. The WPCC is manned seven days of the week with 24-hour standby provisions for after hour alarm response.

Table 1 - Staff Overview

| Engineering and Public Works | |
|---|--|
| Robert Niewenhuizen , A.Sc.T., Director of Engineering and Public Works | |
| Jenn Wilson , P.Eng., LEED® AP, City Engineer | |
| Utilities Division | |
| Gerry Rasmuson , B.Sc. <i>Utilities Manager</i> <ul style="list-style-type: none"> ◆ Level IV - Water Distribution ◆ Level IV - Wastewater Treatment ◆ Level I - Wastewater Collection | Larry Kipp <i>Utilities Supervisor</i> <ul style="list-style-type: none"> ◆ Level I - Wastewater Collection |
| Mervin Arvay <ul style="list-style-type: none"> ◆ Level II - Wastewater Collection | Devon Tulak <ul style="list-style-type: none"> ◆ Level I - Wastewater Collection |
| Ray Muller <ul style="list-style-type: none"> ◆ Level I - Wastewater Collection | ◆ |
| Jason Baker <ul style="list-style-type: none"> ◆ Level I - Wastewater Collection | Jason Philps <ul style="list-style-type: none"> ◆ Level I - Wastewater Collection |
| Water Pollution Control Centre | |
| Hart Frese <i>Chief Operator</i> <ul style="list-style-type: none"> ◆ Level IV - Wastewater Treatment | Doug Stalker , Dip. Water Quality <i>Operator III</i> <ul style="list-style-type: none"> ◆ Level IV - Wastewater Treatment ◆ Level I - Wastewater Collection |
| Daryl Warnock , RSE, Dip. Water Quality <i>Operator III</i> <ul style="list-style-type: none"> ◆ Level II - Wastewater Treatment | Damon Kipp , B.Sc., Dip. Water Quality <i>Operator III</i> <ul style="list-style-type: none"> ◆ Level I – Wastewater Treatment |

2.0 Wastewater Treatment & Collection System History

2.1 Wastewater Collection System - History


The District of Salmon Arm and the Village of Salmon Arm amalgamated in 1971 to form the District Municipality of Salmon Arm on January 1, 1971, and then became the City of Salmon Arm in 2005. The Village was the original urban core area and sewer lines were installed during the 1930's to collect septic tank effluent and some crude wastes which were then discharged into an open ditch leading into Shuswap Lake. The surrounding District Municipality relied on septic systems as sewer collection was not an issue until the urban development of the Village overflowed into the surrounding Municipality. By 1964, the Village had initiated plans for sewage treatment which



included the construction of a lagoon along the waterfront for treatment. The lagoons would also service the Adams lake Indian Band lands. Concerned about the level of treatment that a lagoon offered, the Village decided to review their plans and objectives. By 1966, the review board recommended that the Village and District combine in their efforts to collect and treat wastewater. However, unable to agree upon implementation of various plans the Village applied to the Pollution Control Board for a permit to discharge highly treated effluent into Shuswap Lake. By the time this permit was granted in 1972, the Village and District had amalgamated.



Ultimately the Engineering firm of Dayton and Knight Ltd were hired to undertake a Wastewater survey in 1972 to study various different treatment and effluent disposal methods. The Survey resulted in the construction and official opening of the existing Water Pollution Control Centre on May 14, 1977. Furthermore, the survey identified collection system priorities and set in motion the construction of the infrastructure that currently exists. The City's sewage collection and treatment systems have evolved into a well maintained collection system and a state of the art Wastewater Treatment Centre.

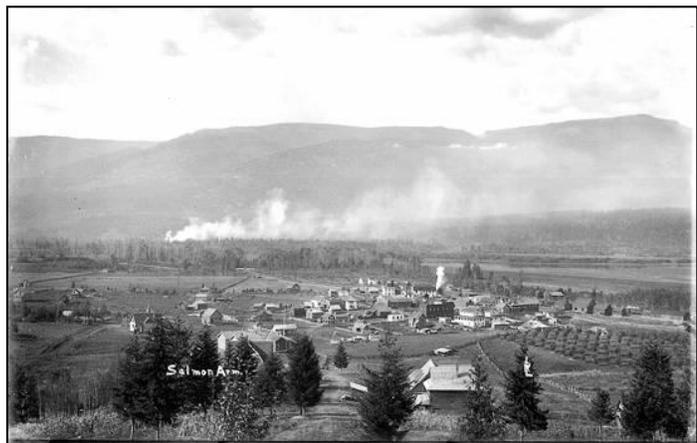

2.2 Wastewater Treatment Plant History

The original plant was constructed on the current site, 121 Narcisse Street NW, in 1977 after the proposed site at Minion Field, 2191 30th Street SW was rejected by the B.C. Agricultural Land Commission and Provincial Pollution Control Board. It was constructed at a cost of \$0.9 M and consisted of primary sedimentation, activated sludge, secondary clarification with chlorine disinfection. Solids were aerobically digested and stored in two 1 acre lagoons. Capacity of the plant was 3,000 m³ per day for a design service population of 6,250.

In 1982, phosphorus removal was added at a cost of \$0.1 M and consisted of precipitating phosphorus out of the effluent by the addition of ferrous chloride. Phosphorus was determined to be the limiting nutrient which contributes to the eutrophication and degradation of water quality in Shuswap Lake, particularly, Salmon Arm Bay. Currently the Salmon Arm WPCW contributes less than 4% of the phosphorus loading in the bay.



Aerial Photo Stage IIIB prior to Landscaping

In 1986 the \$1.8 M Stage II Upgrade was the first major upgrade to the facility. The liquid process was altered from a common activated sludge process to an experimental trickling filter biological nutrient removal (BNR) system (Fixed Growth Reactor – Suspended Growth Reaction or FGR-SGR). As well, the aerobic digester was upgraded to an Autothermal Thermophilic Aerobic Digester (ATAD). Plant Capacity was increased to 3,500 m³ per day for a design service population of 8,750.

Improvements were made in 1991 to the solids process at a cost of \$0.5 M. The improvements consisted of changing aeration and solids pumping equipment. Rebuilding the ATAD tanks and added waste biological sludge thickening.

The Stage III Upgrade was split into two upgrades with the first part, Stage IIIA completed in 1998 at a cost of \$5.2 M. It consisted of improvements to the FGR- SGR process, new secondary clarifier, Supervisory Control and Data Acquisition system, increased ATAD capacity and biosolids dewatering. These improvements led to better control and monitoring, the ability to beneficially recycle biosolids and the decommissioning of the solids storage lagoons. Capacity was increased to 5,000 m³ per day for a design service population of 12,900.

Stage IIIB was completed in 2005 without the Laboratory/Administration expansion. Of the \$7.4 M upgrade, \$2.3 M was funded by the Federal and Provincial Governments.

The upgrade consisted of a complete rebuild of the main lift station at Marine Drive with odour control, added redundancy to critical equipment, stand-by power, effluent filtration, replacement of the chlorination/de-chlorination system with Ultra Violet disinfection, an elaborate odour control system and architectural improvements to the original exterior of the original building.

2.2 Wastewater Treatment Plant History (Cont'd)

Capacity was increased to 6,700 m³ per day average flow for a design service population of 15,000. Stage IIIB was completed in 2008 with the \$0.4 M expansion of the Laboratory/Administration area. The Water Reclamation project was completed in 2010. This project utilizes the highly treated effluent for process water at the facility resulting in a 110 ML annual reduction in potable water use. In 2011, the Trickling Filter Media Upgrade was completed. The total cost of the project was \$0.55 M and entailed removing approximately 1,560 m³ of crossflow media and replacing with vertical flow media. This project was the result of the September 2007 pilot study (Dayton & Knight Ltd.) designed to reduce the impact of sloughing conditions problematic at the facility.



Table 2 - Cost Summary Table

| Project | Cost | Year |
|--|------------------|------|
| Stage I - 6,250 connected population | \$0.9 M | 1977 |
| Chemical Phosphorus Removal | \$0.1 M | 1982 |
| Stage II - 8,250 connected population | \$1.8 M | 1986 |
| Solids Improvements | \$0.5 M | 1991 |
| Stage IIIA - 12,500 connected population | \$5.3 M | 1998 |
| Stage IIIB – 15,000 connected population | \$7.4 M | 2004 |
| Laboratory/Administration Expansion | \$0.4 M | 2008 |
| Reclaimed Water | \$0.1 M | 2009 |
| Trickling Filter Media Upgrade | \$0.55 M | 2011 |
| Total | \$17.05 M | |
| Estimated Insurable/Replacement Value (2005) | \$35.0 M | |

3.0 Wastewater Collection System

3.1 Overview of Collection System

The Utilities Division, through a schedule of systematic new improvements, upgrades and replacements strives to maintain and improve the sanitary sewer collection system. This Division plays an integral role in maintaining the health, safety and well being of the community. The sewer utility is a self-liquidating funded system which must provide for their own revenues through fees, taxes and other charges to support the expenditures required to operate and maintain infrastructure on a daily basis and long into the future.

3.2 Collection System

The City of Salmon Arm’s sanitary sewer collection system consists of 14 sewerage sub areas and 127 km of gravity and force main sanitary sewer pipes covering approximately 1800 hectares. There are approximately 5,977 residential, commercial, industrial and institutional lots fronting onto the sanitary sewer system (2016 Court of Revision Report). There are seven (7) sewer lift stations that collect and pump sewerage to the Lakeshore Sewer Interceptor located on the foreshore where the main lift station, Wharf Street Pump Station, pumps the sewerage directly to the WPCC (see Map 3.2). The Interceptor provides storage and flow equalization capabilities.

3.3 Lift Stations

All seven of the tributary Lift stations are inspected once a week by the City of Salmon Arm’s Utilities Division. All lift stations are thoroughly inspected and cleaned on a monthly basis. The stations are monitored using the City’s SCADA system which enables staff to troubleshoot and trend data on the Cities SCADA system.

Table 3 - Wastewater Facilities

| No. | Wastewater Lift Stations & Facilities | Address |
|-----|--|---------------------------|
| 1 | Water Pollution Control Centre | 121 Narcisse Street NW |
| 2 | Mosquito Park Lift Station | 4290 Canoe Beach Drive NE |
| 3 | Clare's Cove Lift Station | 5391-75 Avenue NE |
| 4 | Captain’s Cove Lift Station | 2251-73 Avenue NE |
| 5 | Canoe Beach Lift Station | 7720-36 Street NE |
| 6 | Wharf Street Pump Station | 1000 Marine Park Drive NE |
| 7 | Rotten Row Lift Station | 681-10 Avenue SW |
| 8 | 10 Avenue SW Lift Station | 2270-10 Avenue SW [TCH] |

3.4 Wharf Street Lift Station

The Wharf Street Lift station is gravity fed by the Lakeshore Interceptor. Three 30 Hp pumps with variable speed drives are used to feed the wastewater facility at rates determined by WPC operators. The station was upgraded in 2002 with each pump rated at 80 liters/sec flow. The foul air is treated by utilizing ultraviolet light which catalyses the breaking of ambient oxygen and water vapor molecules into O⁺ and OH⁻ ions. These free radicals oxidize the odourous contaminants in the air. This reaction results in a sequential and instantaneous gas breakdown of the contaminants with minimal by-products, such as elemental sulfur, CO₂, water vapor, molecular oxygen and trace ozone. In the event of an extended power outage, there is the capability to connect the City's portable generator to the station to run the pumps. A second portable generator was purchased in 2011 primarily to service this critical lift station. This generator was utilized in July of 2012 when a primary Hydro feed to the electrical sub station failed resulting in a localized 33 hour power outage.



3.5 Lift Station Repairs and Modifications

In 2016, the City installed a standby natural gas generator for Rotten Row Lift Station.

3.6 Sanitary Flushing

Approximately 30 km of sanitary mains were flushed in 2016 as part of the maintenance program. Certain main lines and services of concern are flushed quarterly.

3.7 Main and Service Interruptions

There was one mainline blockages within the sanitary collection system in 2016 and only a handful of service interruptions which are typically attributed to grease build up within the service pipe from homeowners or roots from nearby trees and shrubbery.

3.8 Inflow and Infiltration Monitoring Program

The program identifies locations where storm water or ground water enters the sanitary system. We continue to provide system improvements in an effort to reduce the amount of rainwater and groundwater entering the sanitary sewer system when it is cost-effective to do so. Reduction of Inflow & Infiltration (I&I) in the system lowers the risk of sanitary sewer overflows and can decrease the costs of conveying and treating wastewater.

3.9 Wastewater Collection Capital Projects

Table 4 - Capital Project Information

| Capital projects completed in 2016 |
|--|
| ♦ Sanitary Master Plan |
| ♦ Sanitary Foreshore Main Rehabilitation Phase 1 design |
| ♦ Renew sanitary main 6 th Street NE |
| ♦ Install Genset for Rotten Row lift station |
| ♦ Sanitary Main Renewal Canoe Beach |
| ♦ Sanitary servicing strategy – Canoe & Captains Cove |
| ♦ Ongoing SCADA and GIS development |
| Capital Projects scheduled for 2017 |
| ♦ Replace HMI Wharf St. Liftstation. |
| ♦ Sanitary Foreshore Main Rehabilitation Phase 1 |
| ♦ Renew the sanitary main 2 nd St SE off 5 th to 10 th Ave SE |
| ♦ Claires Cove Sanitary Forcemain |
| ♦ Mosquito Lift Station New Pump |
| ♦ Sanitary Main relining 49 th – 50 th St NE |
| ♦ PLC and Radio Upgrade |
| ♦ SCADA iFix Upgrade |

4.0 Wastewater Treatment - Water Pollution Control Centre (WPCC)

The City of Salmon Arm WPCC is located at 121 Narcisse Street N.W. which is located west of the City's Town Centre adjacent to the Shuswap Lake. This section of the report will detail the performance and operational strategies of the plant during the past year.



WPCC – After renovations



Wharf Street Lift Station

4.1 Process Overview

The process of wastewater treatment can be separated into two flow streams – liquid and solids also referred to as the liquid train and solids train.

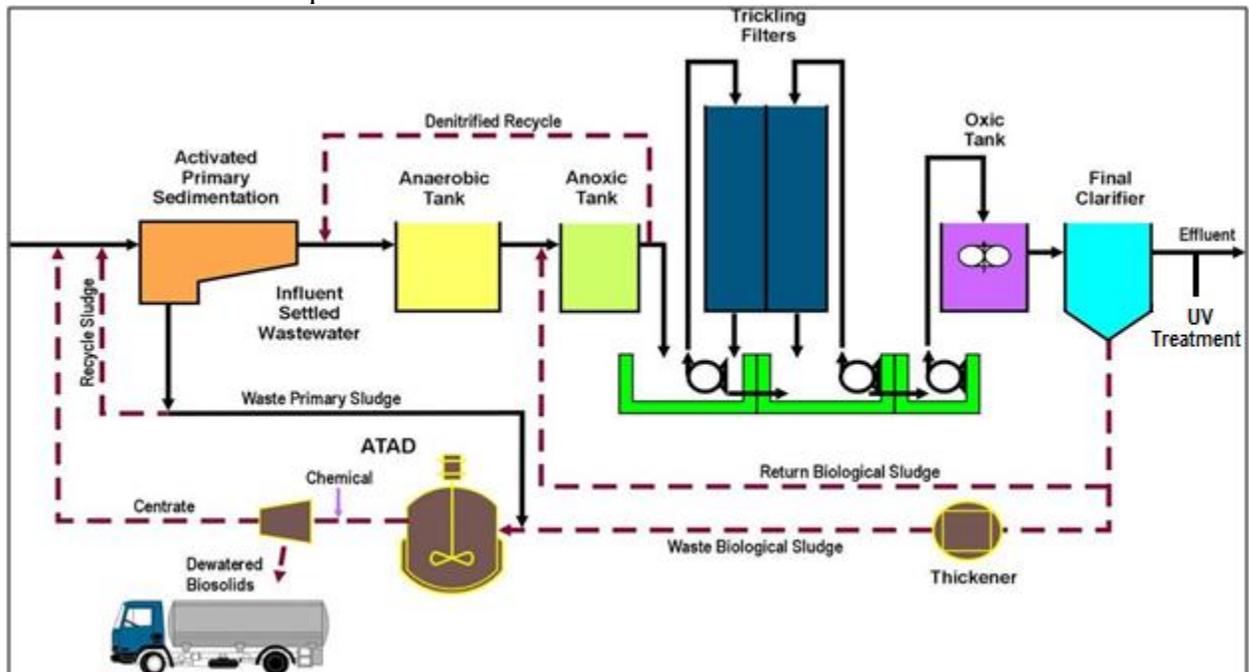


Figure 1: Wastewater Treatment Overview

Initially the wastewater flows into the plant from a sewage lift station located at Marine Park Drive. The influent then passes through several mechanical devices to remove large particles

City of Salmon Arm
2016 Annual Wastewater Collection and Treatment Report

including rocks, rags, plastics and grit. This is done in the headworks of the facility and prevents damage to downstream equipment.



Headworks



Primary Sedimentation Tanks

The flow then enters the Primary Sedimentation Tanks where heavier organic and inorganic solids are settled out of the liquid stream. These particles are then pumped to the ATAD for stabilization. The liquid, on the other hand, then enters the tertiary BNR and SGR-FGR part of the facility for further treatment.



SGR's




FGR

The tertiary treatment involves the use of bacteria to convert degradable organic matter into bacterial cells. These cells are then separated from the liquid in the secondary clarifiers.

The growth portion of the bacteria is removed from the process by thickening and pumped to the ATAD while the remainder is recycled back to the incoming wastewater. This maintains a balance of food (wastewater organics) to micro organisms.

The secondary effluent then passes through the Aqua Aerobics disk filtration system which provides 10 micron filtration, the effluent is then disinfected using a Wedeco Ideal Horizons Ultra Violet Light (UV) disinfection system prior to it being discharged into the Salmon Arm Bay in the Shuswap Lake.

City of Salmon Arm
2016 Annual Wastewater Collection and Treatment Report

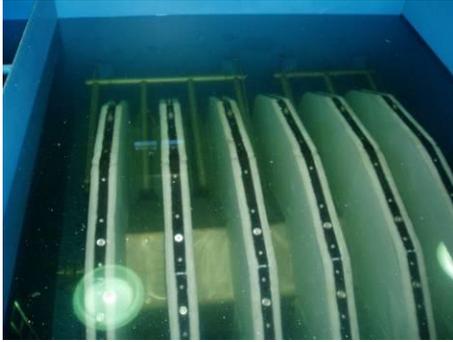

Cloth Disk Filters



Secondary Clarifiers



UV Treatment System



UV Bulbs

Solids are digested to form biosolids in the high temperature ATAD. This process uses high temperature bacteria (60 to 70 degrees Celsius) to stabilize and pasteurize the biosolids. Following processing, the biosolids are thickened with the use of high speed centrifuges and the biosolids are then incorporated with soil to produce a high quality top soil.



Centrifuge



Train B Odour Scrubber

Odour control is another major component of the plant operation. The odour control has been separated into two trains based on the concentration of odour generating compounds. One train deals with a large air volume of low odour concentration while the second train deals with a low air volume with a high concentration of odour compounds. The latter system uses a multi treatment system – biofilter, ozone contact, four (4) stage chemical scrubber and dilution while the other system uses a single stage chemical scrubber.

City of Salmon Arm
2016 Annual Wastewater Collection and Treatment Report



Single Stage Chemical Scrubber



ATAD & Piping



Generator Set, Train B - Odour Control and Filtration Building

4.2 Flows

Plant flows increased by less than 0.5% in 2016. The average daily flow was 4,406 m³/d while in 2015 it was 4,388 m³/d. The highest flow of 5,706 m³/d was recorded on January 29 when rain combined with snow melt increasing the inflow and infiltration in the collection system.



Outfall with marker buoy

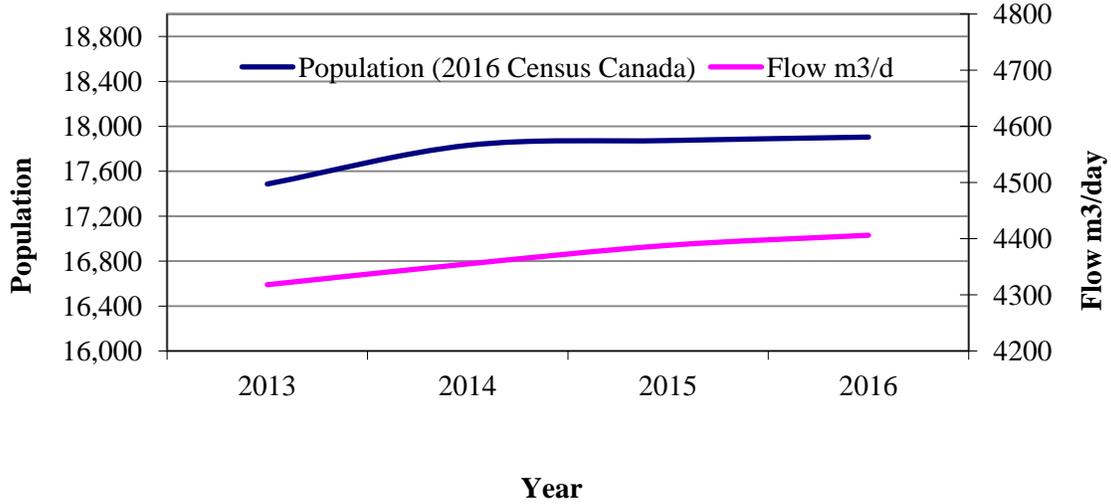


Figure 2: Yearly Average Daily Flow

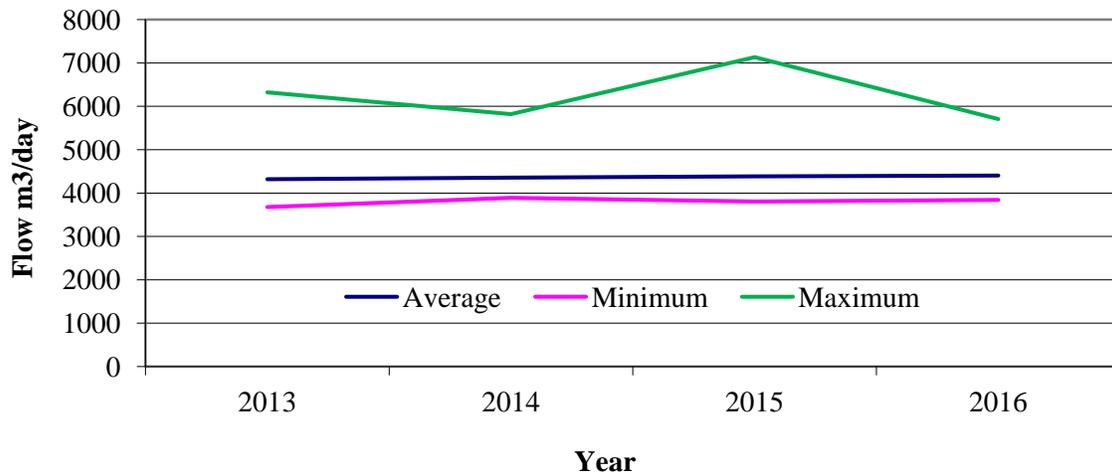


Figure 3: Minimum, Maximum and Average Daily Flows

4.3 Nutrient Removal

Phosphorus concentration is the key nutrient contributing to poor water quality in the Salmon Arm Bay as it is in most lakes in British Columbia. The WPCC contributed approximately 1.3% of the phosphorus loading to the Salmon Arm Bay in 2016. This is a 12% reduction in phosphorus loading from the previous year. Additional information on the health of the entire Shuswap Lake is available from the **Summary: 2011–2013 Water Quality Monitoring Results for Shuswap and Mara Lakes** and can be viewed at http://www.slippbc.ca/images/pdf/2011-13_WQ_Summary.pdf.

City of Salmon Arm
2016 Annual Wastewater Collection and Treatment Report

Key points contained in the Summary are:

- The most significant source of phosphorus and other nutrients to the Shuswap and Mara Lakes is the Shuswap River. The Salmon and Eagle Rivers contribute the second and third largest loadings of phosphorus to the lakes.
- The largest non-point source of nutrients (over 95%) comes from seepage and run-off from agricultural lands in the Shuswap, Salmon and Eagle River watersheds. This source affects water quality in the lakes much more significantly than other sources do, and should be a management focus.
- If all wastewater treatment plants in the Shuswap increased their capability to tertiary treatment (some are now operating a secondary treatment level), this would likely achieve the largest reduction in nutrients from a permitted point-source.
- Within Shuswap and Mara Lakes, the largest direct nutrient inputs occur naturally from decaying salmon following spawning.

Shuswap Lake Integrated Planning Process, "Summary: 2011–2013 Water Quality Monitoring Results for Shuswap and Mara Lakes" Pages 9, 10

Table 5 – Phosphorus Mass Loading to Salmon Arm Bay from Salmon River, White Creek, Tappen Creek and Salmon Arm WPCC at 2016 Concentration and Flow – Daily Annual Averages

| Total Mass Load (kg/d) | Salmon River* | | White Creek* | | Tappen Creek* | | WPCC Year 2016 | |
|------------------------|--------------------|------------|--------------------|------------|--------------------|------------|----------------|------------|
| | 1985 - 1999 (kg/d) | % of Total | 1987 - 1990 (kg/d) | % of Total | 1988 - 1990 (kg/d) | % of Total | (kg/d) | % of Total |
| 74.5 | 65.7 | 88.3% | 6.9 | 9.3% | 0.9 | 1.2% | 1.0 | 1.3% |

*Data supplied from WPCC Outfall Impact Study, August 2002 (Dayton & Knight Ltd.)

Table 6 - Effluent Quality Summary - Yearly

| Parameter (mg/l) | 2008 | 2009 | 2010 | 2011 | 2012 | 2013 | 2014 | 2015 | 2016 | Permit |
|--|------|------|------|------|------|------|------|------|------|--------|
| Flow (m ³) | 4595 | 4698 | 4603 | 4406 | 4382 | 4318 | 4355 | 4388 | 4406 | 8200 |
| Total Phosphorus (mg/l) | 0.64 | 0.66 | 0.49 | 0.35 | 0.58 | 1.13 | 0.77 | 0.25 | 0.22 | 1.0 |
| Kg P per Day | 2.94 | 3.07 | 2.26 | 1.54 | 2.55 | 4.88 | 3.35 | 1.09 | 0.95 | 8.2 |
| Kg P per Year | 1073 | 1121 | 823 | 563 | 931 | 1781 | 1224 | 397 | 347 | 2993 |
| Suspended Solids (mg/l) | 7.9 | 10.2 | 9.6 | 7.9 | 7.4 | 7.2 | 5.4 | 4.4 | 4.8 | 40 |
| BOD ₅ (mg/l) | 7.7 | 3.6 | 4.9 | 4.8 | 7.5 | 6.5 | 8.3 | 5.8 | 6.7 | 30 |
| Ortho Phosphorus (mg/l) | 0.21 | 0.17 | 0.10 | 0.04 | 0.11 | 0.51 | 0.32 | 0.04 | 0.03 | N/A |
| Ammonia (mg/l) | 20.8 | 10.3 | 13.5 | 10.4 | 4.5 | 6.6 | 9.4 | 5.5 | 7.0 | N/A |
| Nitrate & Nitrite (mg/l) | 4.4 | 8.7 | 4.9 | 6.7 | 8.7 | 8.8 | 8.3 | 10.8 | 11.6 | N/A |
| NH ₄ NO ₃ NO ₂ (mg/l) | 25.1 | 19.0 | 18.4 | 16.7 | 13.1 | 15.4 | 17.0 | 16.3 | 18.4 | N/A |

City of Salmon Arm
2016 Annual Wastewater Collection and Treatment Report

Table 7 - Effluent Quality Summary - Weekly

| Test Data | S.S. mg/l | BOD mg/l | Ortho P mg/l | Total P mg/l | NH ₄ mg/l | NO _x mg/l | Oxic MLSS mg/l |
|--------------------|--------------|-------------|-----------------|-----------------|-------------------------|-------------------------|-------------------|
| January 7, 2016 | 4.7 | 5.8 | 0.00 | 0.189 | 8.9 | 9.6 | 5043 |
| January 14, 2016 | 6.6 | 5.1 | 0.00 | 0.225 | 6.4 | 13.7 | 5082 |
| January 21, 2016 | 4.7 | 4.9 | 0.00 | 0.191 | 8.7 | 11.5 | 5049 |
| January 28, 2016 | 4.0 | 4.4 | 0.00 | 0.188 | 5.9 | 12.3 | 5156 |
| February 4, 2016 | 5.4 | 4.8 | 0.00 | 0.206 | 9.0 | 10.5 | 5293 |
| February 10, 2016 | 6.5 | 5.1 | 0.02 | 0.236 | 14.5 | 9.0 | 5231 |
| February 18, 2016 | 5.2 | 4.7 | 0.02 | 0.177 | 13.6 | 8.2 | 4768 |
| February 25, 2016 | 3.8 | 3.7 | 0.00 | 0.176 | 16.3 | 9.7 | 4716 |
| March 3, 2016 | 5.1 | 4.4 | 0.02 | 0.282 | 19.2 | 6.4 | 4595 |
| March 10, 2016 | 4.7 | 9.9 | 0.03 | 0.271 | 23.0 | 8.0 | 4474 |
| March 17, 2016 | 4.3 | 5.5 | 0.05 | 0.150 | 5.1 | 8.8 | 4420 |
| March 24, 2016 | 5.8 | 8.3 | 0.05 | 0.263 | 13.8 | N/A | 4672 |
| March 31, 2016 | 6.7 | 8.3 | 0.06 | 0.344 | 13.0 | 7.8 | 5166 |
| April 7, 2016 | 10.7 | 11.6 | 0.02 | 0.355 | 3.4 | 11.7 | 5397 |
| April 14, 2016 | 9.5 | 8.1 | 0.01 | 0.354 | 3.8 | 10.8 | 5646 |
| April 21, 2016 | 8.8 | 8.9 | 0.06 | 0.314 | 10.0 | 8.0 | 5447 |
| April 28, 2016 | 6.7 | 6.7 | 0.03 | 0.260 | 7.1 | 10.1 | 5391 |
| May 5, 2016 | 7.0 | 6.9 | 0.03 | 0.262 | 5.4 | 9.2 | 4800 |
| May 12, 2016 | 6.4 | 4.7 | 0.03 | 0.220 | 3.4 | 17.5 | 4728 |
| May 19, 2016 | 5.6 | 5.9 | 0.06 | 0.239 | 7.9 | 11.8 | 4615 |
| May 26, 2016 | 5.8 | 5.7 | 0.03 | 0.216 | 3.5 | 12.5 | 4570 |
| June 2, 2016 | 4.9 | 6.8 | 0.02 | 0.201 | 6.5 | 10.6 | 4468 |
| June 8, 2016 | 3.7 | 8.2 | 0.04 | 0.213 | 4.4 | 11.2 | 4233 |
| June 16, 2016 | 5.8 | 7.8 | 0.05 | 0.164 | 6.1 | 14.5 | 4249 |
| June 23, 2016 | 4.7 | 7.0 | 0.07 | 0.148 | 4.8 | 9.3 | 4294 |
| June 30, 2016 | 2.7 | 5.4 | 0.06 | 0.172 | 2.1 | 9.6 | 4246 |
| July 7, 2016 | 3.7 | 6.5 | 0.07 | 0.151 | 3.0 | 13.1 | 4254 |
| July 14, 2016 | 2.1 | 7.8 | 0.03 | 0.154 | 2.6 | 15.2 | 4315 |
| July 21, 2016 | 3.1 | 8.3 | 0.05 | 0.198 | 1.6 | 12.5 | 4033 |
| July 28, 2016 | 2.6 | 9.0 | 0.03 | 0.193 | 3.7 | 13.1 | 3959 |
| August 4, 2016 | 2.6 | 11.4 | 0.03 | 0.185 | 4.4 | 11.9 | 4078 |
| August 12, 2016 | 4.2 | 8.5 | 0.05 | 0.205 | 5.1 | 11.0 | 4251 |
| August 18, 2016 | 4.7 | 9.0 | 0.04 | 0.213 | 4.6 | 11.2 | 4253 |
| August 25, 2016 | 3.0 | 8.9 | 0.04 | 0.200 | 5.4 | 9.3 | 4294 |
| September 1, 2016 | 3.3 | 7.5 | 0.01 | 0.205 | 4.6 | 12.1 | 4605 |
| September 8, 2016 | 3.5 | 8.0 | 0.01 | 0.174 | 5.7 | 10.8 | 4597 |
| September 15, 2016 | 2.8 | 7.9 | 0.01 | 0.209 | 5.4 | 12.9 | 4100 |
| September 22, 2016 | 5.1 | 8.8 | 0.03 | 0.211 | 7.8 | 13.9 | 3400 |
| September 29, 2016 | 5.2 | 6.1 | 0.03 | 0.270 | 7.1 | 16.2 | 3338 |
| October 6, 2016 | 5.7 | 8.3 | 0.03 | 0.245 | 4.8 | 9.6 | 3284 |
| October 13, 2016 | 6.0 | 5.4 | 0.03 | 0.264 | 8.3 | 13.4 | 3364 |
| October 20, 2016 | 4.5 | 4.7 | 0.03 | 0.236 | 2.1 | 14.6 | 3589 |
| October 27, 2016 | 5.2 | 4.6 | 0.02 | 0.233 | N/A | 12.6 | 4222 |
| November 3, 2016 | 4.6 | 3.4 | 0.02 | 0.199 | 4.1 | 15.4 | 4259 |
| November 10, 2016 | 4.7 | 4.4 | 0.02 | 0.195 | N/A | 15.2 | 4390 |
| November 17, 2016 | 3.4 | 3.5 | 0.01 | 0.165 | 6.9 | 13.8 | 4392 |
| November 24, 2016 | 3.8 | 3.7 | 0.01 | 0.177 | 2.9 | 12.4 | 4382 |
| December 1, 2016 | 3.4 | 5.8 | 0.01 | 0.164 | 2.0 | 10.5 | 4624 |
| December 8, 2016 | 3.9 | 9.2 | 0.01 | 0.177 | 5.8 | 10.5 | 4700 |
| December 15, 2016 | 2.6 | 8.0 | 0.02 | 0.165 | 5.9 | 14.9 | 4780 |

City of Salmon Arm
2016 Annual Wastewater Collection and Treatment Report

| Test Data | S.S. mg/l | BOD mg/l | Ortho P mg/l | Total P mg/l | NH ₄ mg/l | NO _x mg/l | Oxic MLSS mg/l |
|-------------------|--------------|-------------|-----------------|-----------------|-------------------------|-------------------------|-------------------|
| December 22, 2016 | 5.4 | 7.1 | 0.03 | 0.180 | 7.1 | 10.6 | 4835 |
| December 29, 2016 | 5.4 | 7.1 | 0.03 | 0.242 | 13.4 | 11.8 | 4919 |
| Average | 4.9 | 6.8 | 0.03 | 0.22 | 7.0 | 11.6 | 4519 |
| Maximum | 10.7 | 11.6 | 0.07 | 0.36 | 23.0 | 17.5 | 5646 |
| Minimum | 2.1 | 3.4 | 0.00 | 0.15 | 1.6 | 6.4 | 3284 |

4.4 Fecal Coliform

The ultraviolet disinfection system functioned well during 2016 with no results exceeding 23 MPN/100 ml well below the maximum allowed of 200 MPN/100. In order to meet future flows, this system will be first to require upgrading and as such the City has completed the engineering design.

4.5 Toxicity

As part of the Environment Canada’s Wastewater Systems Effluent Regulations which came into effect January 1, 2013, the City was initially required to test the effluent for toxicity quarterly. Having never failed a toxicity analysis, the frequency was reduced to annually and was completed on effluent collected on November 15th, 2016. Analysis concluded, once again, the effluent discharged from the facility is non toxic.

4.6 Biosolids

The City of Salmon Arm produced approximately 350 dry tonnes of Class A biosolids during 2015. The biosolids are used by the Columbia Shuswap Regional District for local landfill reclamation. Testing of the biosolids by CARO Environmental Services for nutrients, metals and fecal coliform occurred on November 15th. Test results, once again, verified the biosolids produced by the Auto Thermophilic Aerobic Digester (ATAD) were of the highest quality managed under the Organic Matter Recycling Regulation.

4.7 Operating Certificate

The City operates the WPCC under draft Operating Certificate issued by the BC Ministry of Environment. The certificate is attached as **Appendix B**.

In addition, The City’s system must also comply with Environment Canada’s Wastewater Systems Effluent Regulations. The goal of the Regulation is to standardize wastewater treatment across Canada. The Regulation specifies conditions to be met in order for the discharge of wastewater including setting limits on the concentration of deleterious substances that are authorized to be deposited, as well as requirements concerning effluent monitoring, toxicity, record keeping and reporting. Since the City’s Operation Certificate is generally more stringent, only additional monitoring by an accredited laboratory and reporting is required to meet the Regulation.

4.8 Liquid Waste Management Plan

The City’s Liquid Waste Management Plan (LWMP) was adopted by City Council on November 2, 2004 and was subsequently approved by the Ministry of Environment (MOE). One of the commitments contained in the approved LWMP was to carry out a LWMP update during 2009 to review progress, update the schedule, and make any required revisions in consultation with MOE. The City has been working with Opus International Consulting Engineer to update LWMP. In the fall of 2010 meetings were held with MOE staff in an effort to review the proposed updates and amendments. Resulting from these discussions a draft LWMP update memorandum has been prepared and submitted for MOE review and comment.


4.9 WPCC Capital Projects

Table 8 – WPCC Capital Project Information

| |
|--|
| WPCC Capital Projects completed in 2016 |
| ♦ Upgraded office computers and printer |
| Staff Initiated WPCC Projects Completed in 2016 |
| ♦ MCC upgrade for larger FGR pump starters |
| ♦ Purchase new FGR pump and installed |
| WPCC Capital Projects scheduled for 2017 |
| ♦ Rebuild Wharf St. Lift Station pump with large capacity impeller |
| ♦ Design Trickling Filter irrigation system |
| ♦ HVAC Network Automation Engine upgrade |
| ♦ Upgrade SCADA computers and associated software |
| ♦ WPCC Capacity Audit |
| ♦ UV Upgrade |


City of Salmon Arm
2015 Annual Wastewater Collection and Treatment Report

APPENDIX A

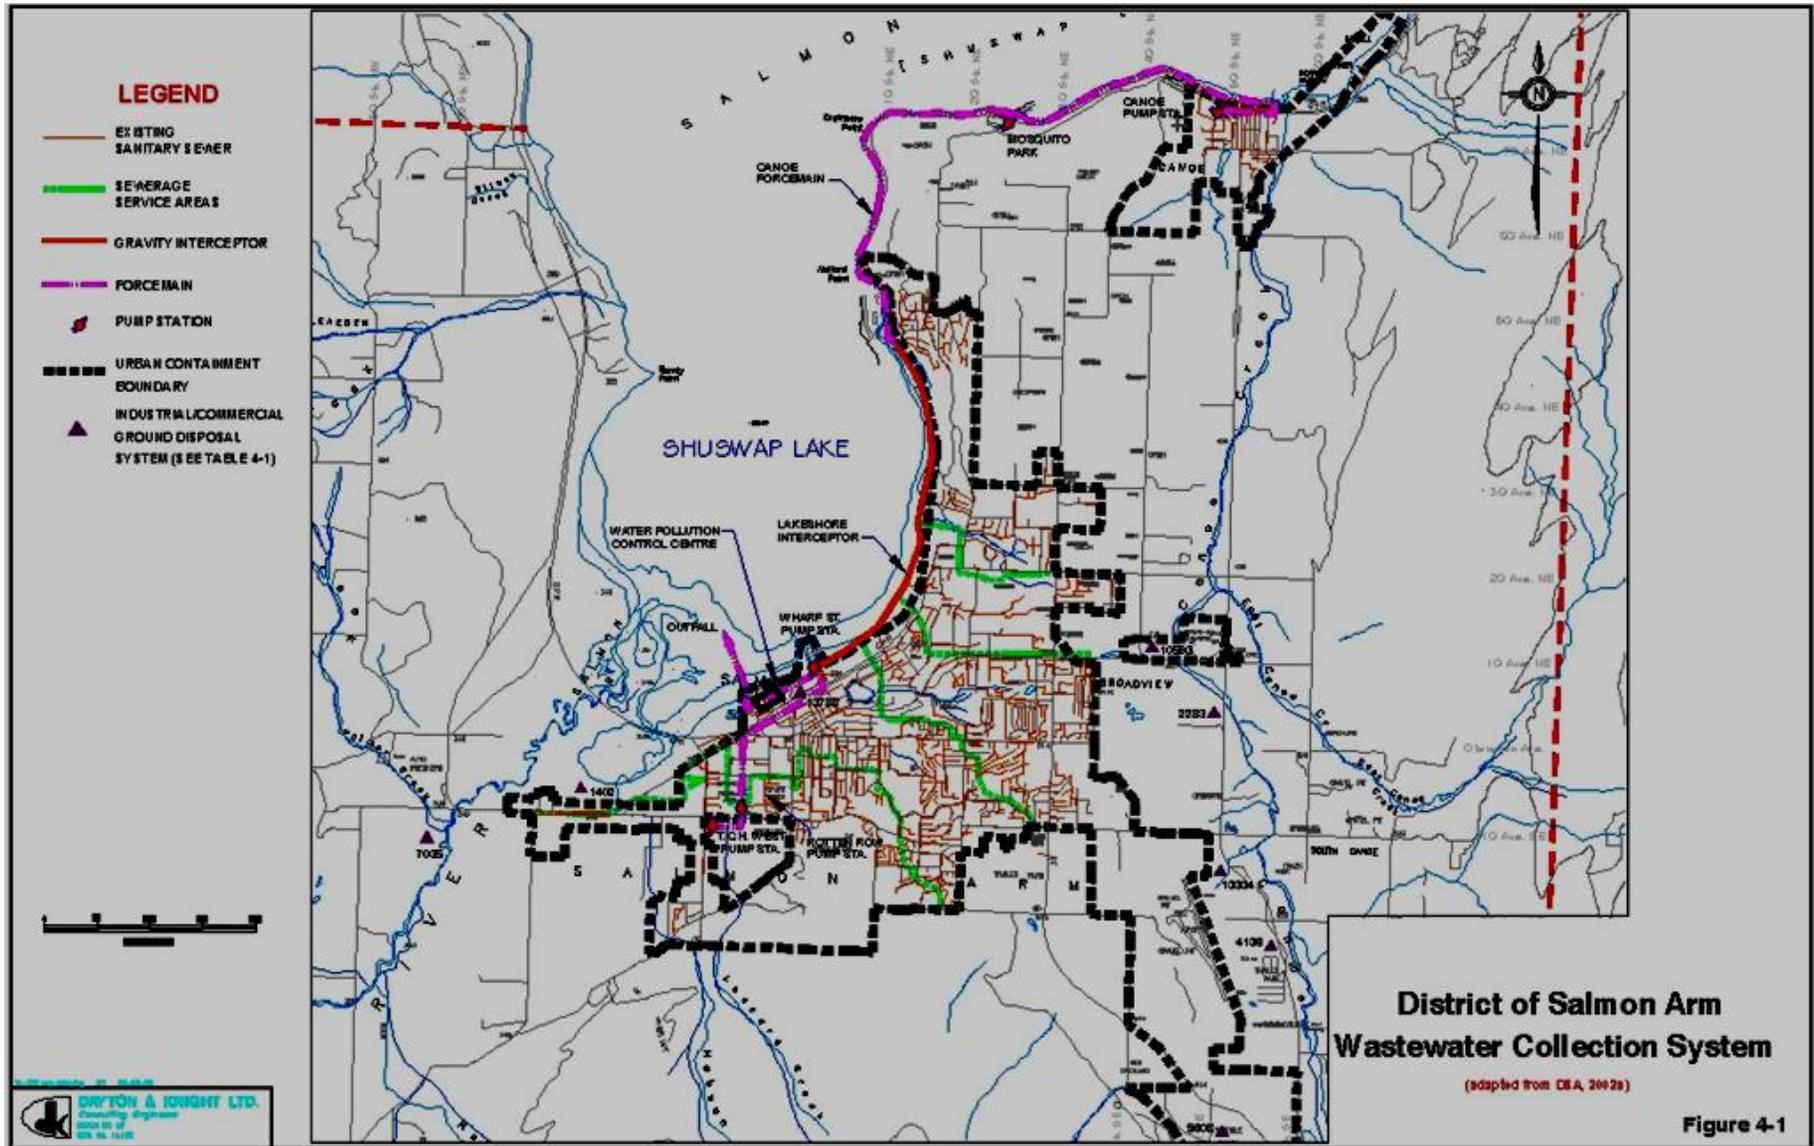

APPENDIX “B”

OPERATIONAL CERTIFICATE

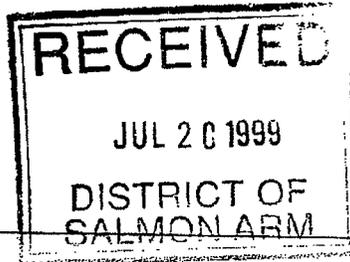PROVINCE OF
BRITISH COLUMBIAMINISTRY OF
ENVIRONMENT,
LANDS AND PARKSEnvironment and Lands
Pollution Prevention
1259 Dalhousie Drive
Kamloops, British Columbia
V2C 5Z5
Telephone: (250) 371-6200
Fax: (250) 828-4000

July 15, 1999

File: PE-1251

REGISTERED MAILDistrict of Salmon Arm
450 - 2nd Avenue NE
PO Box 40
Salmon Arm, BC V1E 4N2

Dear Permittee:

Enclosed is amended Permit PE-1251 issued under the provisions of the *Waste Management Act*. Your attention is respectfully directed to the terms and conditions outlined in the Permit. An annual permit fee will be determined according to the Waste Management Permit Fees Regulation.

This Permit does not authorize entry upon, crossing over, or use for any purpose of private or Crown lands or works, unless and except as authorized by the owner of such lands or works. The responsibility for obtaining such authority shall rest with the Permittee. This Permit is issued pursuant to the provisions of the *Waste Management Act* to ensure compliance with Section 54(3) of that statute, which makes it an offence to discharge waste without proper authorization. It is also the responsibility of the Permittee to ensure that all activities conducted under this authorization are carried out with regard to the rights of third parties, and comply with other applicable legislation that may be in force.

This Permit may be appealed by persons who consider themselves aggrieved by this decision in accordance with Part 7 of the *Waste Management Act*. Written notice of intent to appeal must be received by the Environmental Appeal Board within thirty (30) days of the date of the Permit.

Administration of this Permit will be carried out by staff from the Regional Office located at 1259 Dalhousie Drive, Kamloops, British Columbia V2C 5Z5. Plans, data and reports pertinent to the Permit are to be submitted to the Regional Waste Manager at this address.

Yours truly,

T.R. Forty, P. Eng.
Assistant Regional Waste Manager
Southern Interior Region

enclosure

PROVINCE OF
BRITISH COLUMBIA



Environment and Lands
Pollution Prevention
1259 Dalhousie Drive
Kamloops
British Columbia V2C 5Z5
Telephone: (250) 371-6200
Fax: (250) 828-4000

MINISTRY OF ENVIRONMENT,
LANDS AND PARKS

**PERMIT
PE-1251**

Under the Provisions of the Waste Management Act

District of Salmon Arm

is authorized to discharge effluent to Tappen Bay of Shuswap Lake from a municipal sewerage system located in Salmon Arm, British Columbia, subject to the conditions listed below. Contravention of any of these conditions is a violation of the Waste Management Act and may result in prosecution.

This Permit supersedes and amends all previous versions of Permit **PE-1251**, issued under the Waste Management Act.

This Permit does not authorize entry upon, crossing over, or use for any purpose of private or Crown lands or works, unless and except as authorized by the owner of such lands or works. The responsibility for obtaining such authority shall rest with the Permittee.

Date Issued: July 4, 1972
Dates Amended: June 17, 1976
March 18, 1988
February 7, 1990
July 15, 1999

T.R. Forty, P. Eng.
Assistant Regional Waste Manager

PROVINCE OF
BRITISH COLUMBIA

Pollution Prevention

1. AUTHORIZED DISCHARGES

1.1 This subsection applies to the discharge of effluent from a **MUNICIPAL SEWAGE TREATMENT PLANT**. The site reference number for this discharge is **E212492**.

1.1.1 The maximum authorized rate of discharge is **8200 m³/day**.

1.1.2 The characteristics of the discharge shall not exceed:

| | |
|--|------------------|
| 5 - day Biochemical Oxygen Demand (BOD) | 30 mg/L |
| Non-filterable residue (TSS) | 40 mg/L |
| Chlorine | 0.01 mg/L |
| Total Phosphorus | 1.0 mg/L |

1.1.3 The authorized works are a **fixed growth - suspended growth secondary treatment plant with biological and/or chemical phosphorus removal, chlorination - dechlorination facilities, auto thermophilic aerobic digester, sludge handling facilities, outfall, and related appurtenances** approximately located as shown on attached Site Plan A.

1.1.4 The location of the facilities from which the discharge originates is **Lot 1 of the NW 1/4 of Section 14, Township 20, Range 10, West of the Sixth Meridian, Kamloops Division Yale District, Plan 26245**.

1.1.5 The location of the point of discharge is **unsurveyed Crown Land (all in the bed of Shuswap Lake)**.

2. GENERAL REQUIREMENTS

2.1 Maintenance of Works and Emergency Procedures

The Permittee shall inspect the pollution control works regularly and maintain them in good working order. In the event of an emergency or condition beyond the control of the Permittee which prevents continuing operation of the approved method of pollution control, the Permittee shall immediately notify the Regional Waste Manager and take appropriate remedial action.

2.2 Bypasses

The discharge of effluent which has bypassed the designated treatment works is prohibited unless the approval of the Regional Waste Manager is obtained and confirmed in writing.

Date Issued: July 4, 1972
Date Amended: June 17, 1976
March 18, 1988
February 7, 1990
July 15, 1999



T.R. Forty, P. Eng.
Assistant Regional Waste Manager

PROVINCE OF
BRITISH COLUMBIA

Pollution Prevention

2.3 Process Modifications

The Permittee shall notify the Regional Waste Manager prior to implementing changes to any process that may affect the quality and/or quantity of the discharge.

2.4 Plans - New Works

Plans and specifications of any proposed works shall be submitted to the Regional Waste Manager and the Manager's approval obtained before construction commences. The works shall be constructed in accordance with such plans.

2.5 Posting of Outfall

The Permittee shall erect a sign along the alignment of the outfall above high water mark. The sign shall identify the nature of the works. The wording and size of the sign requires the approval of the Regional Waste Manager.

2.6 Outfall Inspection

The Permittee may be required to conduct a dye test on the outfall line (or inspect by another method approved by the Regional Waste Manager). The test shall be conducted when directed by the Regional Waste Manager.

2.7 Chlorination

The Permittee shall maintain a chlorine residual prior to dechlorination between 0.5 and 1.0 mg/L at all times and provide not less than one hour contact time at average flow rates.

2.8 Dechlorination

The effluent shall be dechlorinated prior to discharge to reduce the chlorine residual to 0.01 mg/L or less.

2.9 Sludge Wasting and Disposal

Sludge wasted from the treatment plant shall be disposed of to a site and in a manner approved by the Regional Waste Manager.

2.10 Operator Certification

The sewage treatment facility shall be classified by the Environmental Operators Certification Program. The Permittee shall ensure that all operators of the facility be certified by the Program to the appropriate level for the facility, and to the satisfaction of the Regional Waste Manager.



T.R. Forty, P. Eng.
Assistant Regional Waste Manager

Date Issued: July 4, 1972
Date Amended: June 17, 1976
March 18, 1988
February 7, 1990
July 15, 1999

PROVINCE OF
BRITISH COLUMBIA

Pollution Prevention

2.11 Phosphorus Study

The Permittee shall retain a suitably qualified professional to study the environmental impact of the phosphorus loading at the maximum discharge rate of 8200 m³/day. The study shall consider the morphology of the lake in the discharge area, other sources of contaminants (i.e. Salmon River, White Creek, stormwater runoff etc.) and the location of the outfall. As well as the phosphorus issue, this study shall address the toxicity of the effluent and the potential impacts on aquatic life, especially during low water conditions. This study shall be complete and submitted for approval by the Regional Waste Manager by December 31, 2000.

3. MONITORING AND REPORTING REQUIREMENTS

3.1 Discharge Monitoring


3.1.1 Composite Sampling

The Permittee shall obtain composite samples of the effluent. The composite samples shall comprise samples taken over a 24 hour period.

The following samples and analyses shall be obtained:

| <u>PARAMETERS</u> | <u>FREQUENCY</u> |
|---|------------------|
| 5-day Biochemical Oxygen Demand | weekly |
| Non-filterable Residue (total suspended solids) | weekly |
| Total Phosphorus | weekly |
| Ammonia | monthly |
| Nitrates | monthly |
| Fecal Coliforms | monthly |
| pH | monthly |
| Toxicity | annually |
| Chlorine | continuous |

Proper care should be taken in sampling, storing and transporting the samples to adequately control temperature and avoid contamination, breakage, etc.

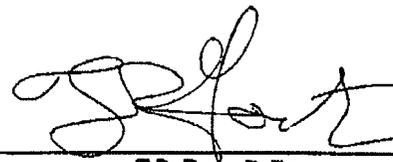

T.R. Forty, P. Eng.
Assistant Regional Waste Manager

Date Issued: July 4, 1972
Date Amended: June 17, 1976
March 18, 1988
February 7, 1990
July 15, 1999

3.2 Monitoring Procedures

3.2.1 Analyses

Analyses are to be carried out in accordance with procedures described in the latest version of "British Columbia Environmental Laboratory Manual for the Analysis of Water, Wastewater, Sediment and Biological Materials, (March 1994 Permittee Edition)", or by suitable alternative procedures as authorized by the Regional Waste Manager.

Copies of the above manual may be purchased from Queen's Printer, P.O. Box 9452, Stn Prov Govt, Victoria, British Columbia V8W 9V7 (1-800-663-6105).

Analyses for determining the toxicity of liquid effluent to fish shall be carried out in accordance with the procedures described in the "Laboratory Procedures for Measuring Acute Lethal Toxicity of Liquid Effluent to Fish", dated November, 1982.

Copies of the above manual may be purchased from the Ministry of Environment, Lands and Parks, P.O. Box 9342, Stn Prov Govt, Victoria, British Columbia, V8W 9M1.

3.2.2 Sampling Location and Techniques

All sampling locations, techniques and equipment require the consent of the Regional Waste Manager prior to use.

Sampling and flow measurement shall be carried out in accordance with the procedures described in "British Columbia Field Sampling Manual for Continuous Monitoring plus the Collection of Air, Air-Emission, Water, Wastewater, Soil, Sediment and Biological Samples", as published by the Ministry of Environment, Lands and Parks, or by suitable alternative procedures as authorized by the Regional Waste Manager.


Copies of the above manual are available from the Ministry of Environment, Lands and Parks, P.O. Box 9342, Stn Prov Govt, Victoria, British Columbia V8W 9M1.

3.3 Flow Measurement

The Permittee shall provide and maintain a suitable flow measuring device and record once per day the effluent volume discharged over a 24-hour period.

3.4 Reporting

The Permittee shall maintain data of analyses and flow measurements for inspection and submit the data, suitably tabulated, to the Regional Waste Manager for the previous month.

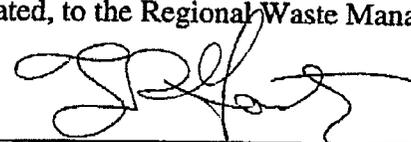

T.R. Forty, P. Eng.
Assistant Regional Waste Manager

Date Issued: July 4, 1972
Date Amended: June 17, 1976
March 18, 1988
February 7, 1990
July 15, 1999


3.5 Annual Report

The Permittee shall submit an annual report on or before March 31 of each year.

The annual report shall review and interpret monitoring data for the preceding calendar year and provide graphical analysis with suitable interpretations of any trends in the monitoring results.

The annual report shall review the performance of the sewage treatment system and identify any necessary changes to the treatment process and for works.

Date Issued: July 4, 1972
Date Amended: June 17, 1976
March 18, 1988
February 7, 1990
July 15, 1999

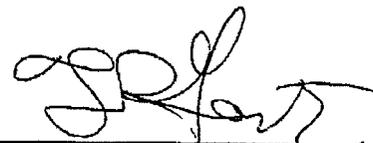


T.R. Forty, P. Eng.
Assistant Regional Waste Manager


PROVINCE OF
BRITISH COLUMBIA

Pollution Prevention


SITE PLAN A

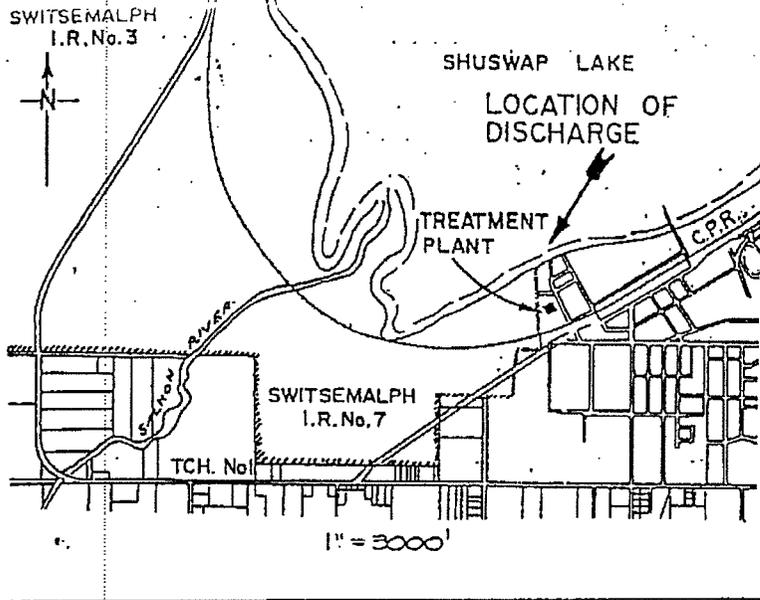

LOCATION OF DISCHARGE

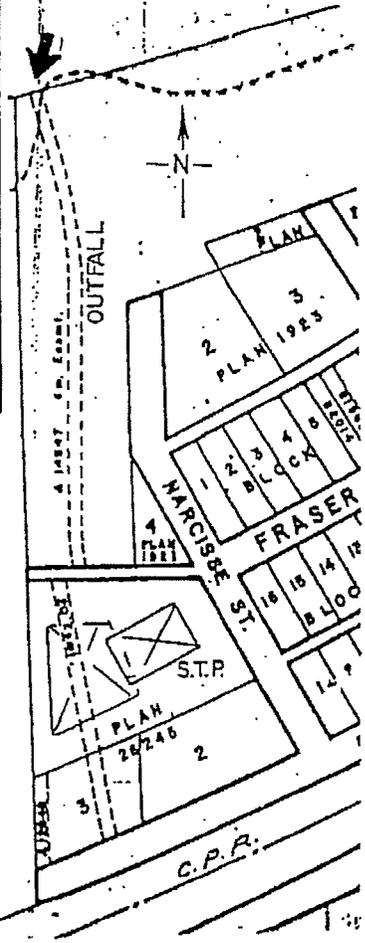

Location Map

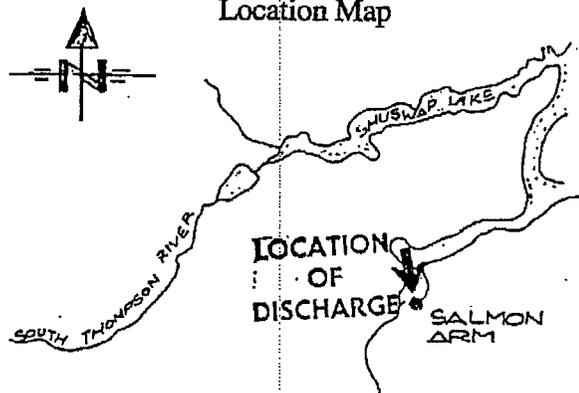

Permit: PE-1251

Date: July 15, 1999

T.R. Forty, P. Eng.
Assistant Regional Waste Manager



Province of
British Columbia

Ministry of
Environment,
Lands and Parks

BC
Environment

Southern Interior Region
1259 Dalhousie Drive
Kamloops
British Columbia
V2C 5Z5
Telephone: (604) 371-6200

October 21, 1996

File: PE 11402

REGISTERED MAIL

District of Salmon Arm
P.O.Box 40
450-2nd Ave NE
Salmon Arm, BC V1E 4N2

Dear Permittee:

Enclosed is Permit PE-11402 issued under the provisions of the Waste Management Act. Your attention is respectfully directed to the terms and conditions outlined in the permit. An annual permit fee will be determined according to the Waste Management Permit Fees Regulation.

This permit does not authorize entry upon, crossing over, or use for any purpose of private or Crown lands or works, unless and except as authorized by the owner of such lands or works. The responsibility for obtaining such authority shall rest with the permittee. This permit is issued pursuant to the provisions of the Waste Management Act to ensure compliance with Section 34(3) of that statute, which makes it an offence to discharge waste without proper authorisation. It is also the responsibility of the permittee to ensure that all activities conducted under this authorization are carried out with regard to the rights of third parties, and comply with other applicable legislation that may be in force.

This permit may be appealed by persons who consider themselves aggrieved by this decision in accordance with Part 5 of the Waste Management Act. Written notice of intent to appeal must be received by the Regional Waste Manager within twenty-one (21) days.

Administration of this permit will be carried out by staff from the Regional Office located at 1259 Dalhousie Drive, Kamloops, BC., V2C 5Z5. Plans, data and reports pertinent to the permit are to be submitted to the Regional Waste Manager at this address.

Yours truly,

Donald K. May, P.Eng.
Assistant Regional Waste Manager

enclosure

PROVINCE OF
BRITISH COLUMBIA

Environmental Protection
1259 Dalhousie Drive
Kamloops
British Columbia V2C 5Z5
Telephone: (604) 371-6200

MINISTRY OF ENVIRONMENT,
LANDS AND PARKS

PERMIT
PE 11402


Under the Provisions of the Waste Management Act

The District of Salmon Arm

is authorized to discharge thermophilically digested biosolids from a Sewage Treatment Plant located in Salmon Arm, British Columbia to land located in and around the District of Salmon Arm, British Columbia, subject to the conditions listed below. Contravention of any of these conditions is a violation of the Waste Management Act and may result in prosecution.

This Permit does not authorize entry upon, crossing over, or use for any purpose of private or Crown lands or works, unless and except as authorized by the owner of such lands or works. The responsibility for obtaining such authority rest with the Permittee.

Date issued: October 21, 1996
Amendment Date:
(most recent)
Page: 1 of 4



Donald K. May, P. Eng.
Assistant Regional Waste Manager

PERMIT NO.: PE 11402

PROVINCE OF
BRITISH COLUMBIA

Environmental Protection

1. AUTHORIZED DISCHARGES

1.1 This subsection applies to the discharge of thermophilically digested biosolids from the District of Salmon Arm Water Pollution Control Centre located at 121 Narcisse Street SW in Salmon Arm.

1.1.1 The maximum authorized rate of discharge is 1500 cubic metres of thermophilically digested biosolids per year.

1.1.2 The characteristics of the biosolids shall be equivalent to or better than typical pasteurized sludge from the autothermophilic digestion of sewage sludge.

1.1.3 The authorized works are biosolids storage facilities, biosolids spreaders and related appurtenances.

2. Location of the Facilities

The lands to which the biosolids are to be applied are legally described as:

a) Lot 2, Plan KAP 47072, Section 7, Township 20, Range 9, Kamloops Division Yale District, West of the Sixth Meridian.

b) Various other locations in and around the District of Salmon Arm area, subject to written authorization by the Regional Waste Manager on a site specific basis.

c) Technical information regarding sites referred to in Section 2. (b) must be submitted to the Regional Waste Manager for review, at least 60 days prior to the intended commencement of biosolids application. The Regional Waste Manager, at his discretion, may require public notification of the intent to discharge biosolids. If it is determined that such notification is required, the Permittee will be informed in writing by the Regional Waste Manager. The Permittee shall bear the costs of such notification.

3. GENERAL REQUIREMENTS Applicable to the Authorized Discharges

3.1 Biosolids shall have been stabilized by an acceptable process of digestion or composting. More stabilization may be required by the Regional Waste Manager if odour or vector problems develop.


Donald K. May, P. Eng.,
Assistant Regional Waste Manager

PROVINCE OF
BRITISH COLUMBIA

Environmental Protection

- 3.2 Biosolids shall be applied to land in accordance with the *draft Guidelines for Disposal of Domestic Sludge under the Waste Management Act (attached)*
- 3.3 Movement of biosolids and/or constituents off-site, subsequent to application, the result of rain, wind, water, or freeze-thaw conditions is prohibited.
- 3.4 Biosolids shall not be applied to frozen or snow covered land or to land with a slope of 10% or more.
- 3.5 Biosolids shall not be applied within 30 metres of a surface waterbody.
- 3.6 Biosolids shall be applied in a manner consistent with acceptable agricultural practise, as outlined in the *Agricultural Waste Control Regulation, B.C. Reg. 131/92*.
- 3.7 Biosolids shall not be applied to land where the groundwater table at the time of application is within one metre of the surface.
- 3.8 Public access to biosolids treated sites shall be controlled by means satisfactory to the Regional Waste Manager.
- 3.9 The Regional Waste Manager may prohibit application of biosolids to a site if, in his opinion, any substance in the soil is approaching levels detrimental to health and/or the environment.

4. Process Modifications


The Permittee shall notify the Regional Waste Manager prior to implementing changes to any process that may affect the quality and/or quantity of the discharge.

5. Bypasses

The discharge of biosolids which has bypassed the designated treatment works is prohibited unless the consent of the Regional Waste Manager is obtained and confirmed in writing.

6. Monitoring

The soils to which the biosolids are to be applied shall be analyzed prior to each application and once after each application of biosolids as directed by the Regional Waste Manager. The soils shall be analyzed for the following parameters:

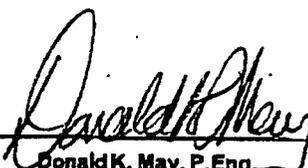
Donald K. May, P. Eng
Assistant Regional Waste Manager

PROVINCE OF
BRITISH COLUMBIA

Environmental Protection

| | | | |
|---------|----------|------------|-------------------------|
| Arsenic | Chromium | Mercury | Selenium |
| Cadmium | Copper | Molybdenum | Zinc |
| Cobalt | Lead | Nickel | Total Kjeldahl Nitrogen |

The biosolids to be applied to the ground shall be analyzed once annually or as otherwise specified by the Regional Waste Manager. Analysis shall be in accordance with Schedule C of the *draft Guidelines for Disposal of Domestic Sludge under the Waste Management Act*.

Soils and biosolids sampling shall be conducted in accordance with the soils and biosolids sampling methodology defined in the *draft Guidelines for Disposal of Domestic Sludge under the Waste Management Act*.

The Regional Waste Manager may require the monitoring of vegetation grown on the land treated with biosolids.

7. Reporting

The Permittee shall keep records of the quantity of biosolids discharged, the application rate (kg/ha), the areas and locations of land treated with biosolids, and analysis for inspection by Environmental Protection staff and submit the data suitably tabulated to the Regional Waste Manager for the previous year by January 31st of the next year.